

Feature:

- Water Clear Lens
- 3 mm lens Piranha
- Package in Tube
- InGaN
- Super Flux Output
- 50 ° Viewing angle

Description:

This Super Flux LED has 3 mm lens height. It is ideal for automotive lighting applications.

Application:


- Automotive lighting
- General lighting

Certification & Compliance:

- TS16949
- ISO9001
- RoHS Compliant



Dimension:

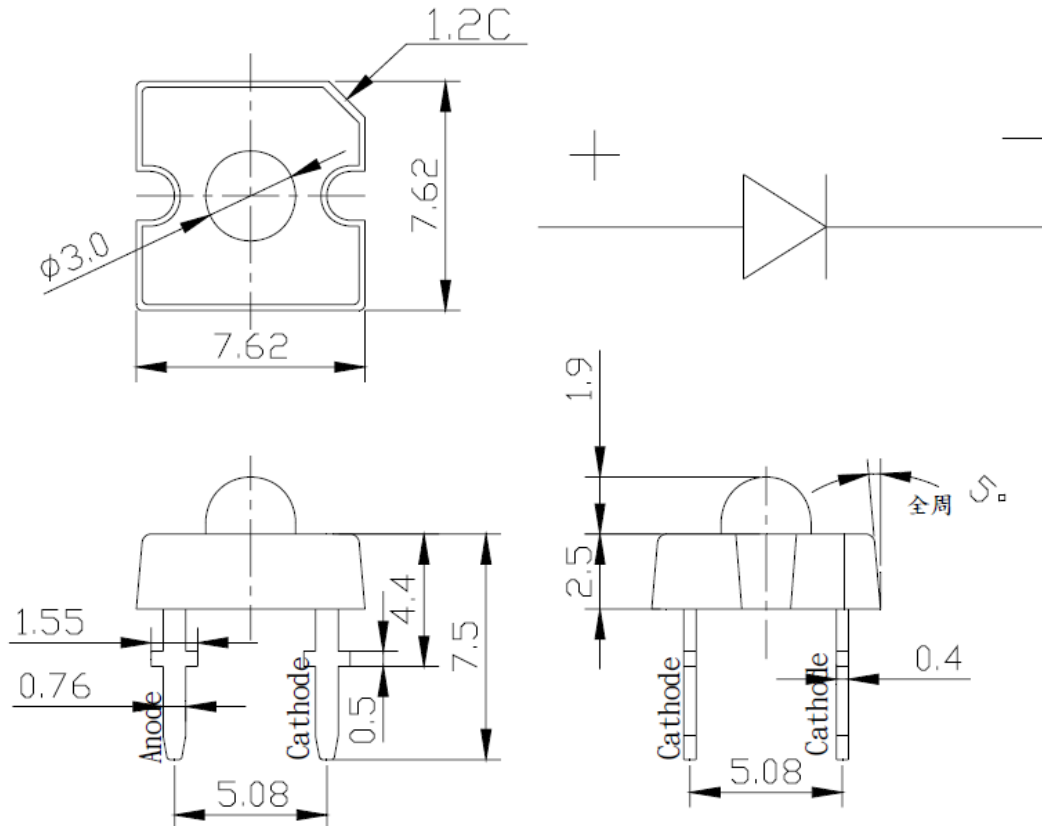

Units: mm / tolerance = +/-0.2mm

Electrical / Optical Characteristic ($T_A=25^\circ\text{C}$)

Product	Color	I_F (mA)	V_F (V)		λ_D (nm)			Φ_V (mlm)	
			Typ.	max	Min.	Typ.	Max.	Min	Typ.
QBPP350C-IB	Blue	20	3.2	4.0	462	---	473	740	1300


Absolute Maximum Rating


Material	P_d (mW)	I_F (mA)	I_{FP} (mA)*	V_R (V)	T_{OP} ($^\circ\text{C}$)	T_{ST} ($^\circ\text{C}$)	T_{SOL} ($^\circ\text{C}$)**	ESD (V)
InGaN	200	50	100	5	-30 to +80	-40 to +100	260	6000

*Duty 1/10 @0.1ms Pulse Width

** IR Reflow for no more than 5 sec @ 260 $^\circ\text{C}$


Characteristic Curves For InGaN:

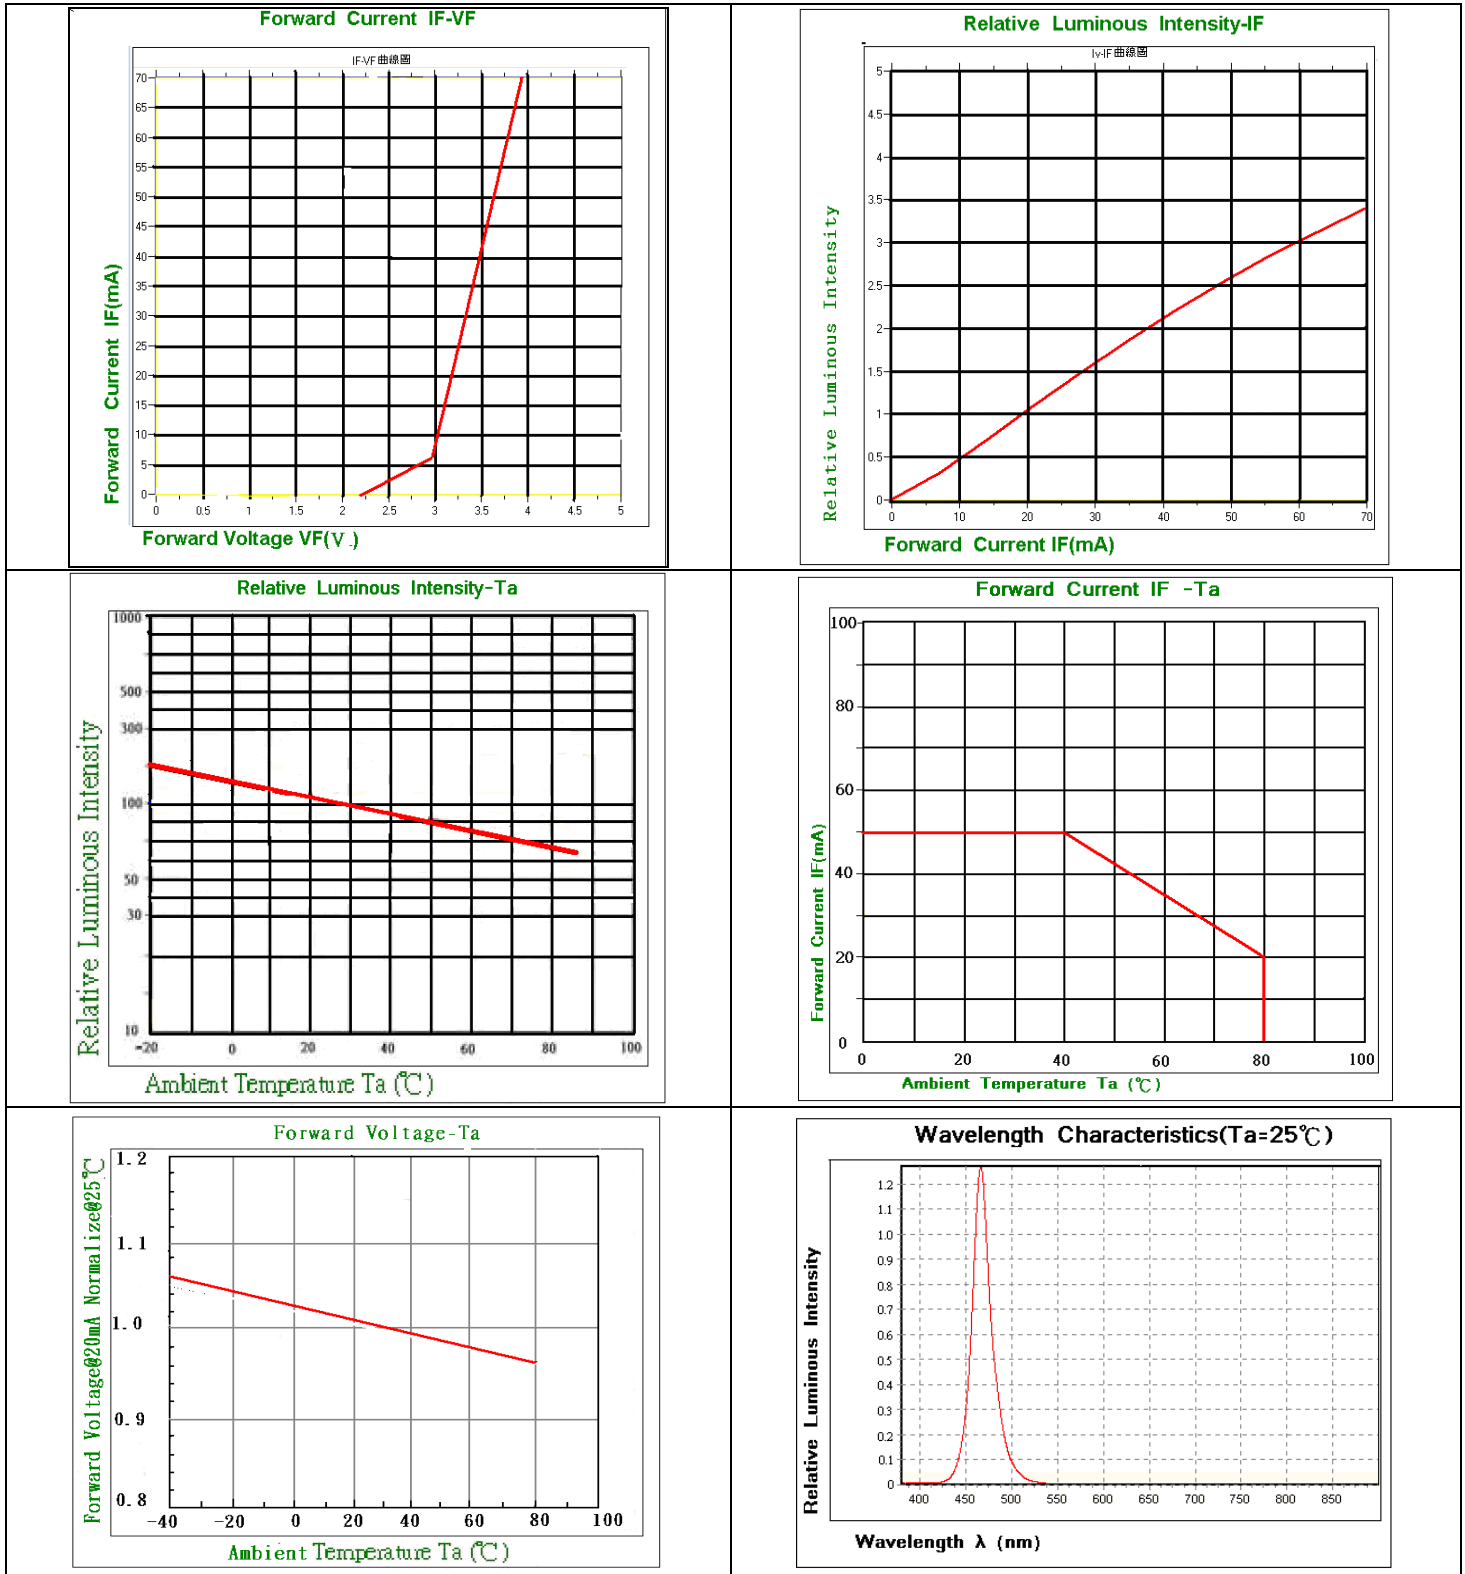

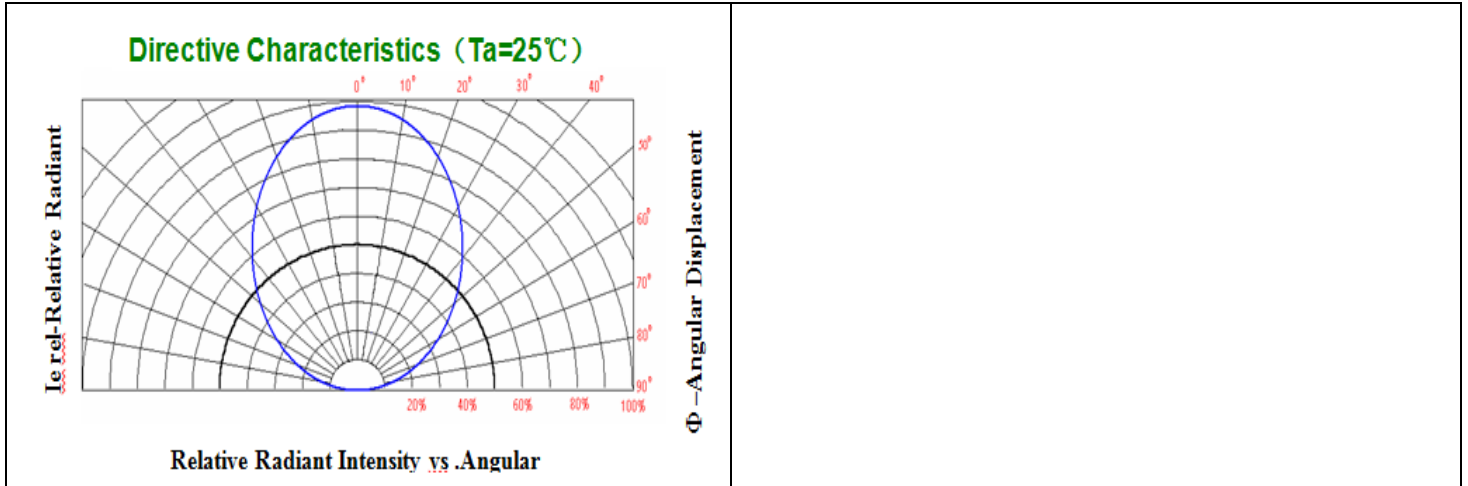

Solder Profile & Footprint:

WAVE SOLDERING PROFILE FOR LEAD FREE PROCESS:

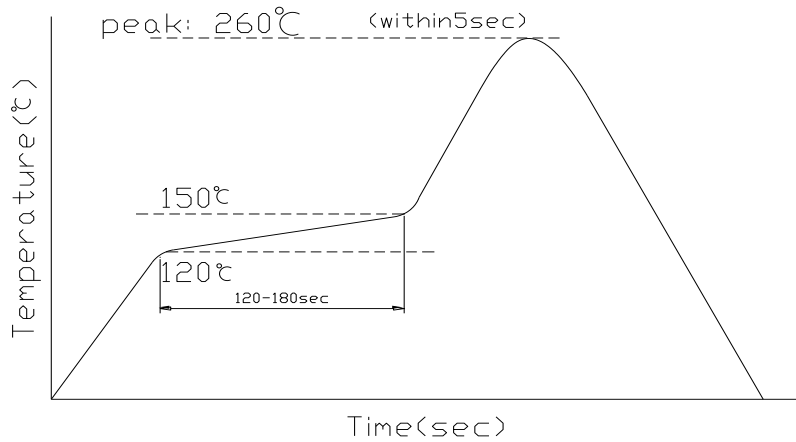

Packing: TBD

Product: QBPP350C-IB	Date: June 25, 2011	Page 4 of 6
	Version# 1.0	

Labeling:

Part No: _____

Customer P/N: _____

Item: _____

Q'ty: _____

Vf: _____

Iv: _____

WI: _____

Date: _____

Made in China**Ordering Information:**

Part #	Orderable Part #	Spec Range	Quantity per Tube
QBPP350C-IB	QBPP350C-IB	$\Phi v = 1300 \text{ mlm typ. @ } I_F=20\text{mA}$ $\lambda_D=462-473\text{nm}$	TBD

Revision History:

Description:	Revision #	Revision Date
New Release of QBPP350C-IB	V1.0	06/25/2010

Disclaimer

QT-BRIGHTTEK reserves the right to make changes without further notice to any products herein to improve reliability, function or design. QT-BRIGHTTEK does not assume any liability arising out of the application or use of any product or circuit described herein; neither does it convey any license under its patent rights, nor the rights of others.

Life Support Policy

QT-BRIGHTTEK's products are not authorized for use as critical components in life support devices or systems without the express written approval of QT-BRIGHTTEK. As used herein:

1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.